ANDERSEN CORPORATION

100 SERIES NON-REINFORCED

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE 1X BUCKING, SHEATHING, & WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- 7. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
 - D. HOLLOW BLOCK CMU UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL MINIMUM WALL THICKNESS OF 54 MILS (16 GA.) WHEN THROUGH GUSSET INSTALLATION.
 - ALUMINUM 1/8" MINIMUM THICKNESS (6063-T5)

GENERAL NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 5TH EDITION (2014) FLORIDA BUILDING CODE (FBC) EXCLUDING HVHZ, 2012 INTERNATIONAL BUILDING CODE & 2012 INTERNATIONAL RESIDENTIAL CODE. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE 2014 FBC AND THE FOLLOWING:
 - AAMA 450-10
 - FBC SECTION 1710.5.3
- 2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS. ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE PERA OR AHJ.
- 5. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- 6. MULLION MATERIAL:
- 6.1. NON-REINFORCED: FIBERGLASS
- 6.2. LVL REINFORCED: LAMINATED VENEER LUMBER, (MIN. DOUGLAS-FIR, E = 1,800 KSI, Fb = 2,400 PSI)
- 7. IN ACCORDANCE WITH THE 2014 FBC, DISSIMILAR METALS INCLUDING FASTENERS SHALL BE PROTECTED FROM GALVANIC CORROSION.
- 11.CUSTOM SIZES AVAILABLE UPON REQUEST. CUSTOM DESIGN PRESSURE WILL BE ASSIGNED EQUAL TO NEXT LARGER STANDARD SIZE.
- 12.INTERIOR TRIM OPTIONS MAY VARY IN ACCORDANCE WITH ANDERSEN'S RECOMMENDATIONS.
- 13.MULL ASSEMBLIES ARE QUALIFIED FOR TWO OR MORE UNITS PER OPENING IN THE FOLLOWING CONFIGURATION:
- "ONE WAY" RIBBON OR STACKED MULLIONS
- "TWO WAY" 'X' OR 'T' MULLIONS, SEE SHEET 13 FOR TYPICAL ELEVATION TYPES.

& LVL MULLION JOINING

		TABLE OF CONTENTS
SHEET	REVISION	SHEET DESCRIPTION
1	-	GENERAL AND INSTALLATION NOTES
2	-	MULL ASSEMBLY SECTIONS - NON-REINFORCED MULLS
3	-	MULL ASSEMBLY SECTION - LVL REINFORCED MULLS
4	-	NON-REINFORCED INSTALLATION DETAILS
5	1-	LVL REINFORCED INSTALLATION DETAILS
6	-	GROUP I: ONE-WAY NON-REINFORCED MULL DP TABLE FOR INSTALLATION TO 2X WOOD/METAL STUD/CONCRETE
7	-	GROUP I: ONE-WAY NON-REINFORCED MULL DP TABLE FOR INSTALLATION TO HOLLOW BLOCK OR GROUT FILLED CMU
8	-	GROUP II: ONE-WAY NON-REINFORCED MULL DP TABLE FOR INSTALLATION TO 2X WOOD/METAL STUD/CONCRETE
9	-	GROUP II: ONE-WAY NON-REINFORCED MULL DP TABLE FOR INSTALLATION TO HOLLOW BLOCK OR GROUT FILLED CMU
10	.=	GROUP III: ONE-WAY NON-REINFORCED MULL DP TABLE FOR INSTALLATION TO 2X WOOD/METAL STUD/CONCRETE
11	-	GROUP III: ONE-WAY NON-REINFORCED MULL DP TABLE FOR INSTALLATION TO HOLLOW BLOCK OR GROUT FILLED CMU
12	-	GROUP IV: ONE-WAY LVL REINFORCED MULL DP TABLE FOR INSTALLATION TO 2X WOOD/METAL STUD/CONCRETE/CMU
13	-	GROUP IV: TWO-WAY LVL REINFORCED MULL DP TABLE FOR INSTALLATION TO 2X WOOD/METAL STUD/CONCRETE/CMU

P	RODUCT ABBREVIATION KEY
ABBREVIATION	PRODUCT NAME
PW =	PICTURE WINDOW FRAME
CS =	CASEMENT WINDOW FRAME
AW =	AWNING WINDOW FRAME
SH =	SINGLE HUNG WINDOW FRAME
GL =	GLIDING WINDOW FRAME

MISSILE IMPACT RATING

NON-IMPACT

MULLING INSTRUCTIONS:

- STEP 1: ESTABLISH MULL ASSEMBLY FRAME TYPES AND MULL CONFIGURATION.
- STEP 2: VERIFY MULL ASSEMBLY CONSTRUCTION FROM SHEETS 2-3 (REFER TO ABBREVIATION TABLE ABOVE).
- STEP 3: DETERMINE ALLOWABLE LOAD OF MULL ASSEMBLY FROM APPLICABLE LOAD TABLE, REFER TO SHEETS 6-10.
- STEP 4: INSTALL MULLION BASED ON APPLICABLE SPECIFICATIONS & DETAILS SHOWN ON SHEETS 4-5.


Digitally signed by Hermes F. Norero, P.E. Reason: I am approving this document Date: 2016.08.25 19:00:57 -04'00'

FL#: FL15922



100 FOURTH AVE NORTH BAYPORT, MN 55003-1096 (651) 264-5150 FX: (651) 264-5485

MIL		REVISIONS			TITLE: 100 SERIES NON-REINF & LVL MULLIONS
,,,,,,,, ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	NO.	DESCRIPTION	ВУ	ву рате	GENERAL AND INSTALLATION NOTES
\ ★					PREPARED BY:
IIII EEK					BUILDING DROPS, INC.
					398 E. DANIA BEACH BLVD. #338 DANIA BEACH, FL 33004
004 NO. 29578					PH: (954) 399-8478 FX: (954) 744-473

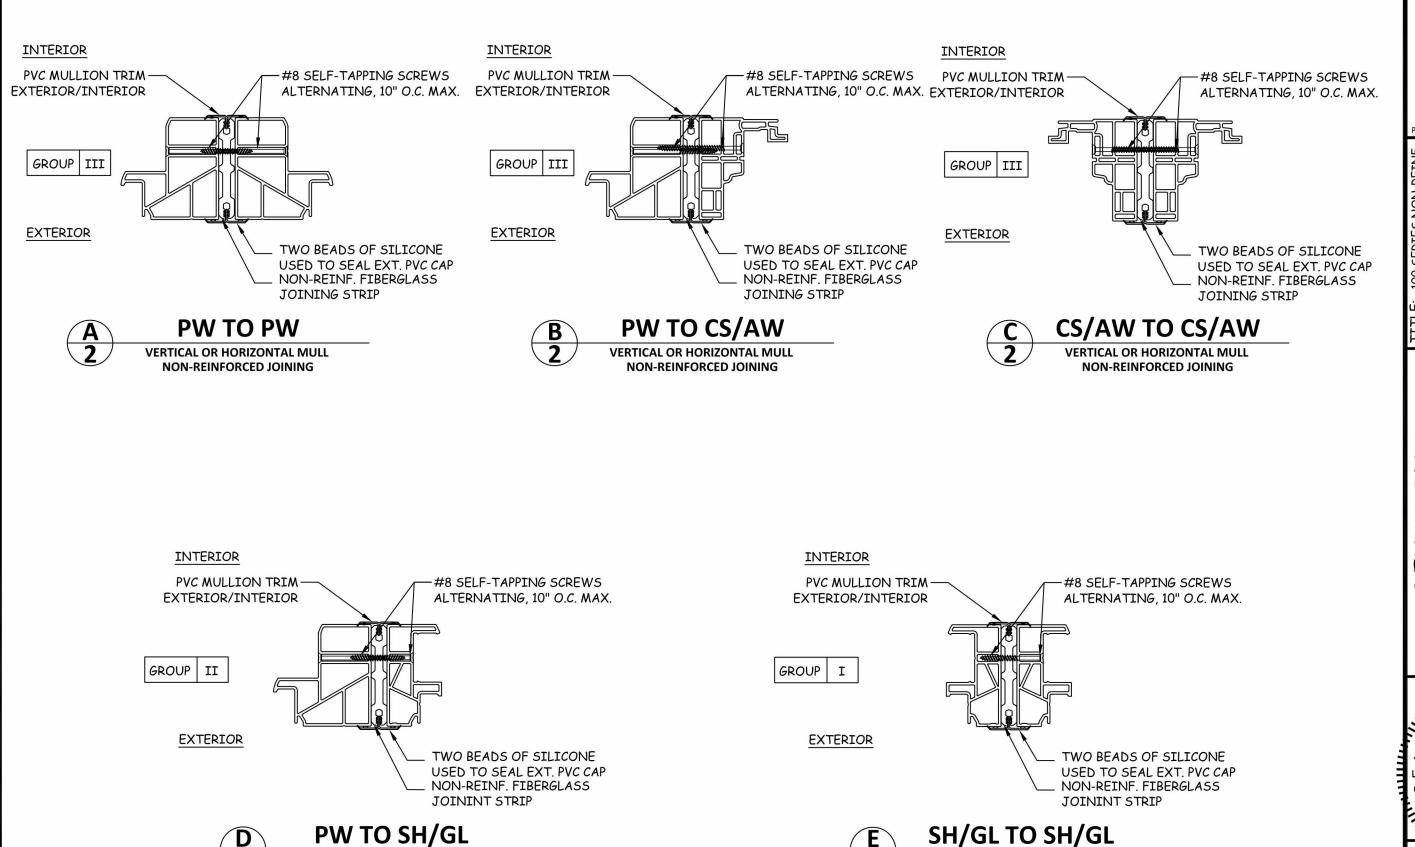

VERTICAL OR HORIZONTAL MULL


NON-REINFORCED JOINING

VERTICAL OR HORIZONTAL MULL

NON-REINFORCED JOINING


Andersen. WINDOWS . DOORS 100 FOURTH AVE NORTH H: (651) 264-5150 FX: (651) 264-5485 DATE BY NOIS DESCRIPTION EVI $\overline{\alpha}$ MINIMINITION * BELLINING

projects\andersen windows\fbc-15-1209 100 series mullion table ve

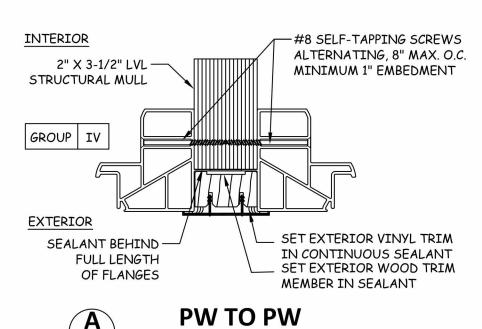

VERTICAL OR HORIZONTAL MULL

LVL REINFORCED JOINING

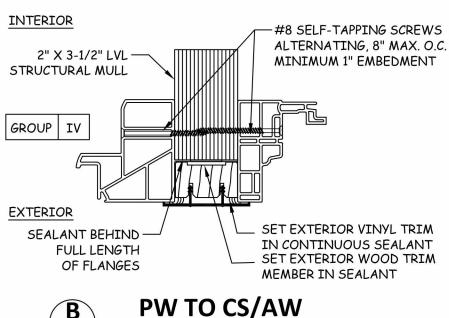


VERTICAL OR HORIZONTAL MULL


LVL REINFORCED JOINING

B


3

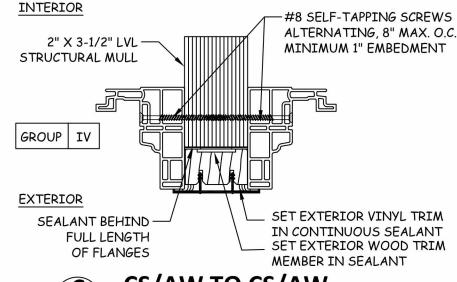




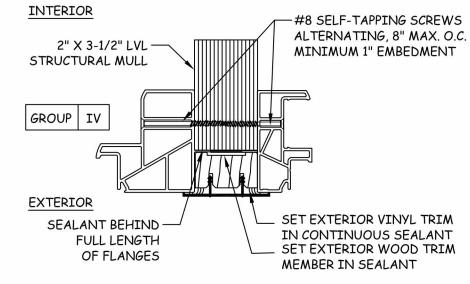




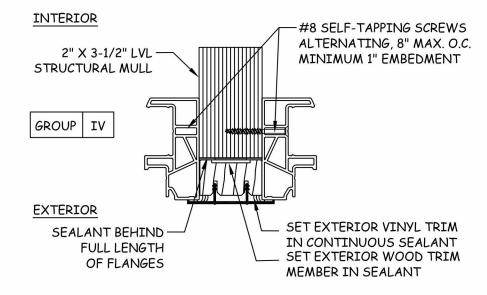




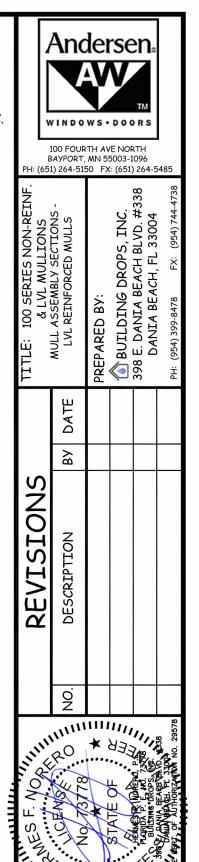










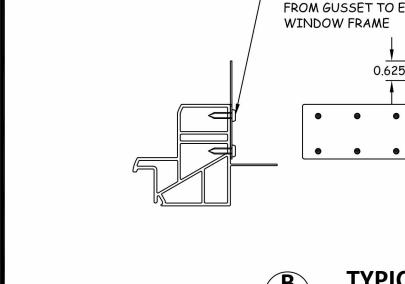

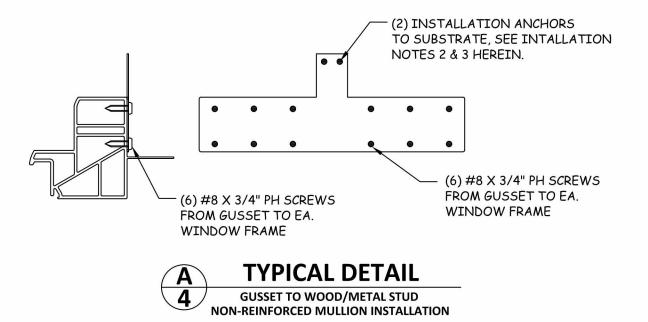

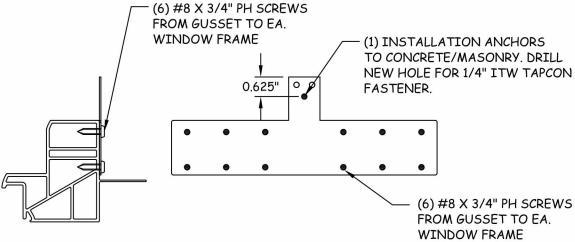



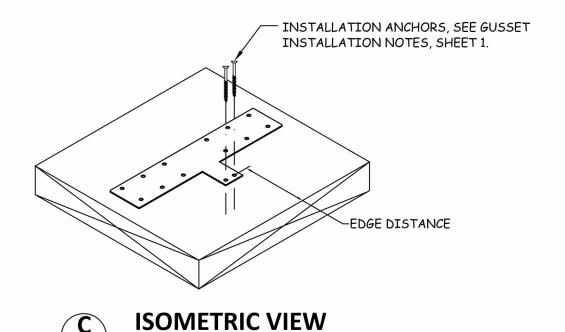


INSTALLATION NOTES:


- 1. EACH WINDOW FRAME SHALL BE ATTACHED TO GUSSET WITH (6) #8 PH X 3/4"
- FOR INSTALLATION THROUGH 2X BUCK USE (2) #10 FH WOOD SCREWS. INSTALLATION SHALL CONFORM TO THE FOLLOWING REQUIREMENTS:

GUSSET INSTALLATION, TYP. NON-REINFORCED MULLION

- 2.1. MINIMUM EMBEDMENT OF 1-1/2" INTO WOOD
- 2.2. MINIMUM EDGE DISTANCE OF 3/4"
- 3. FOR INSTALLATION THROUGH METAL FRAME USE (2) #10 FH SELF-DRILLING OR SELF-TAPPING, SAE GR. 5, TYPE SCREWS. INSTALLATION SHALL CONFORM TO THE FOLLOWING REQUIREMENTS.
 - 3.1. THREE (3) THREADS MINIMUM PENETRATION BEYOND METAL FRAME WALL.
 - 3.2. MINIMUM EDGE DISTANCE OF 1/2"
- FOR INSTALLATION DIRECT TO CONCRETE/MASONRY SUBSTRATES OR THROUGH 1X BUCK TO CONCRETE/MASONRY SUBSTRATES, USE (1) 1/4" FH ITW TAPCON TYP ANCHORS. INSTALLATION SHALL CONFORM TO THE FOLLOWING REQUIREMENTS.
 - 4.1. MINIMUM EMBEDMENT OF 1-3/4" INTO SUBSTRATE
- 4.2. MINIMUM EDGE DISTANCE OF 2"
- "MASONRY" SUBSTRATES REFER TO GROUT FILLED OR HOLLOW BLOCK OPENINGS.
- SEE SHEET 1, INSTALLATION NOTE 7 FOR SUBSTRATE MINIMUM PROPERTIES.




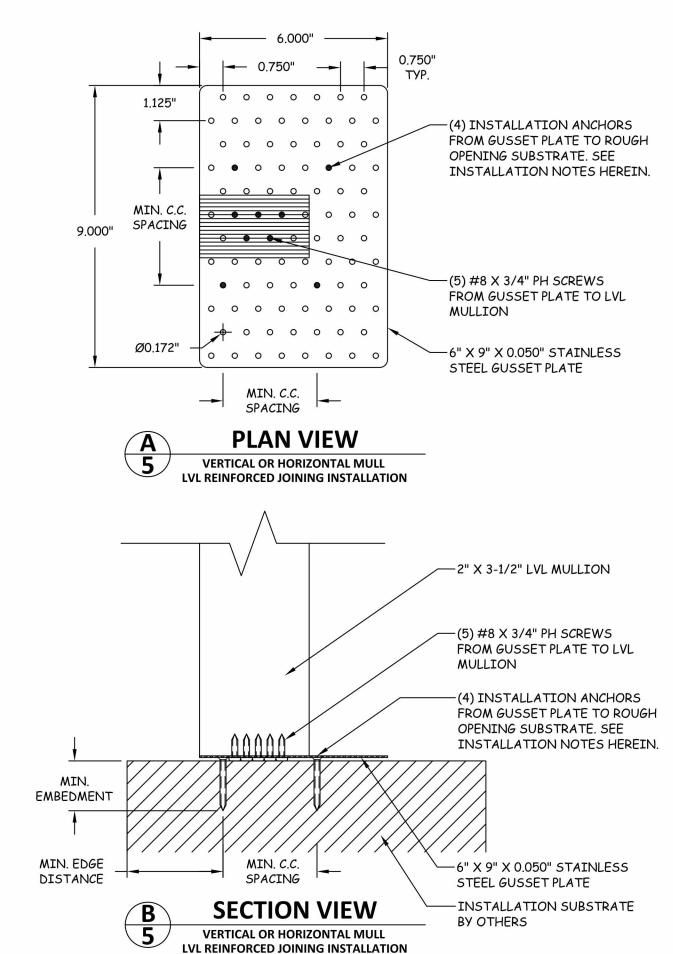

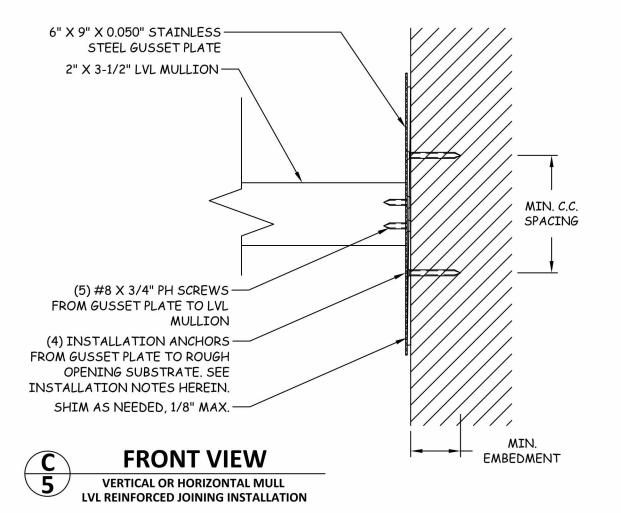

INSTALLATION NOTES:

- GUSSET SHALL BE INSTALLED TO LVL MULLION WITH MIN. (5) #8 X 3/4" PH SCREWS.
- FOR INSTALLATION THROUGH 2X BUCK USE #10 FH WOOD SCREWS. INSTALLATION SHALL CONFORM TO THE FOLLOWING REQUIREMENTS:
 - 2.1. MINIMUM EMBEDMENT OF 1-1/2" INTO WOOD
 - 2.2. MINIMUM EDGE DISTANCE OF 3/4"
 - 2.3. MINIMUM C.C. SPACING OF 3/4"
- FOR INSTALLATION THROUGH METAL FRAME USE #10 FH SELF-DRILLING OR SELF-TAPPING, SAE GR. 5, TYPE SCREWS. INSTALLATION SHALL CONFORM TO THE FOLLOWING REQUIREMENTS.
 - 3.1. THREE (3) THREADS MINIMUM PENETRATION BEYOND METAL FRAME WALL.
 - 3.2. MINIMUM EDGE DISTANCE OF 1/2"
 - 3.3. MINIMUM C.C. SPACING OF 3/4"
- FOR INSTALLATION DIRECT TO CONCRETE/MASONRY SUBSTRATES OR THROUGH 1X BUCK TO CONCRETE/MASONRY SUBSTRATES, USE 1/4" FH ITW TAPCON TYP ANCHORS. INSTALLATION SHALL CONFORM TO THE FOLLOWING REQUIREMENTS.
 - 4.1. MINIMUM EMBEDMENT OF 1-3/4" INTO SUBSTRATE
 - 4.2. MINIMUM EDGE DISTANCE OF 2"
 - 4.3. MINIMUM C.C. SPACING OF 3"
- "MASONRY" SUBSTRATES REFER TO GROUT FILLED OR HOLLOW BLOCK OPENINGS.
- SEE SHEET 1, INSTALLATION NOTE 7 FOR SUBSTRATE MINIMUM PROPERTIES.

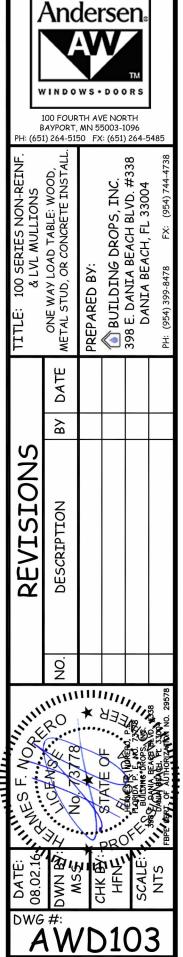



FIBERGLASS NON-REINFORCED MULL TABLE: GROUP I


DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO 2X WOOD/METAL STUD/CONCRETE INSTALLATIONS

					M	AXIMUM DE	SIGN PRESSUI	RE CAPACITY	CHART (PSF): WOOD/N	IETAL STUD/	CONCRETE IN	STALLATION	<u>IS</u>					
L - Mull									W - Tr	ibutary Wic	th (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
54.0	45.0	45.0	45.0	45.0	42.2	39.4	37.3	35.6	34.4	33.4	32.8	32.4	32.3	32.3	32.3	32.3	32.3	32.3	32.3
57.0	45.0	45.0	42.5	38.5	35.4	33.0	31.1	29.6	28.4	27.5	26.8	26.4	26.1	26.0	26.0	26.0	26.0	26.0	26.0
60.0	45.0	40.7	36.2	32.7	30.0	27.9	26.2	24.9	23.8	22.9	22.3	21.8	21.5	21.3	21.2	21.2	21.2	21.2	21.2
63.0	40.3	35.0	31.0	28.0	25.7	23.8	22.3	21.1	20.1	19.3	18.7	18.2	17.9	17.6	17.5	17.4	17.4	17.4	17.4
66.0	35.0	30.3	26.9	24.2	22.2	20.5	19.2	18.1	17.2	16.5	15.9	15.4	15.1	-		-	-	·-	-
69.0	30.5	26.4	23.4	21.1	19.3	17.8	16.6	15.6	-	-	ı	-	-	-	-	-	,_	-	
72.0	26.8	23.2	20.5	18.5	16.8	15.5				-	-	-	-	-	, - , ,	-	y -	-	-
75.0	23.7	20.5	18.1	16.3	-	1	-	-	-	-	-	-	-	-	-	-	-	-	-
78.0	21.0	18.1	16.0	ı	-	1	-	-	:-	-		-	-	J		-	-	\ <u>-</u>	
81.0	18.7	16.2		Į.	-	1		-	-	-	-	-	-	-	-	-	-		-
84.0	16.8	•	-	-	-		-	-	-	-	-	-	-	-	- 5	-	-	-	-
87.0	15.1	ı	-	-	-	1		-	7-	-	1		-	-		-	-	-	-
90.0	-	ı	-	-	-	1		-	-	-	-	-	-	-	1-1	-	-	-	-

- 1. MULLION CHART APPLIES TO NON-REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO 2X WOOD, METAL STUD, OR CONCRETE
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 4 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

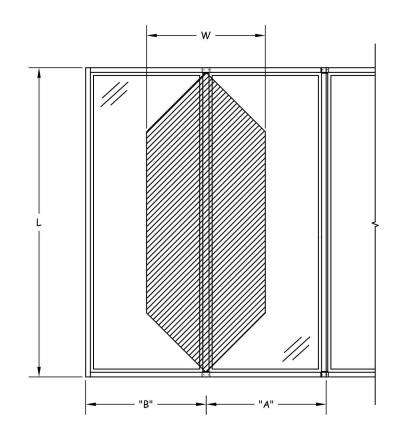

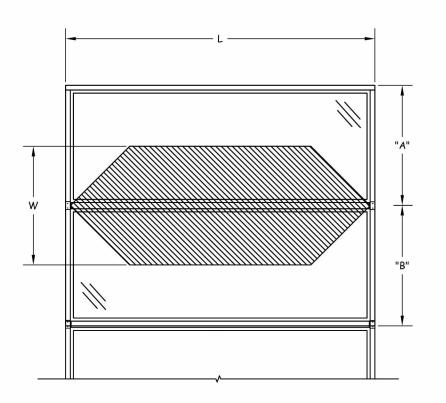

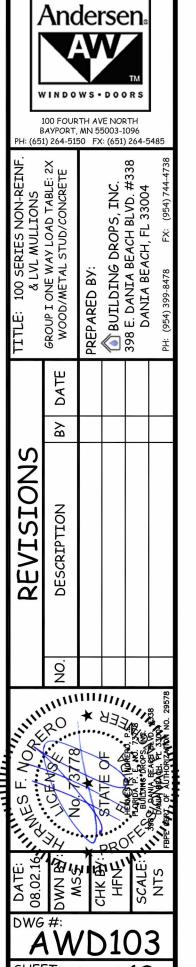



FIBERGLASS NON-REINFORCED MULL TABLE: GROUP I


DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO GROUT FILLED OR HOLLOW BLOCK SUBSTRATES

					MA	XIMUM DES	ign Pressur	E CAPACITY	CHART (PSF)	: GROUT FIL	LED OR HOLL	OW BLOCK I	<u>NSTALLATIO</u>	<u>NS</u>					
L - Mull									W - Tr	ibutary Wic	lth (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	44.5	41.9	39.9	38.4	37.3	36.6	36.1	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0
54.0	45.0	45.0	41.1	37.9	35.4	33.5	32.0	30.8	29.9	29.3	28.8	28.5	28.4	28.4	28.4	28.4	28.4	28.4	28.4
57.0	45.0	42.5	38.4	35.3	32.9	31.0	29.5	28.4	27.4	26.7	26.2	25.8	25.6	25.5	25.5	25.5	25.5	25.5	25.5
60.0	45.0	39.9	36.0	32.7	30.0	27.9	26.2	24.9	23.8	22.9	22.3	21.8	21.5	21.3	21.2	21.2	21.2	21.2	21.2
63.0	40.3	35.0	31.0	28.0	25.7	23.8	22.3	21.1	20.1	19.3	18.7	18.2	17.9	17.6	17.5	17.4	17.4	17.4	17.4
66.0	35.0	30.3	26.9	24.2	22.2	20.5	19.2	18.1	17.2	16.5	15.9	15.4	15.1	F	-	=	=	-	=
69.0	30.5	26.4	23.4	21.1	19.3	17.8	16.6	15.6	-	-	-	-	-	-	-	-	14	= 0	-
72.0	26.8	23.2	20.5	18.5	16.8	15.5	-	-	7-	-	-	-	-	-	-	-	-		-
75.0	23.7	20.5	18.1	16.3	-	-	-	-	-	-	-	-	-	-	-0	-	-	-,	-
78.0	21.0	18.1	16.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	=
81.0	18.7	16.2	-	-	-	-	-	-	~=	-	-	-	-	-	-	-	-	-	-
84.0	16.8	-		-		-	-	-	>-	-	-	-	-		= 0	-	.=	=:	-
87.0	15.1	-	-	-	-	-	=	-) -	-	-		-	14	#0	-		-	-
90.0	-	-	1-	-	=:	-	-	-	7-	-	-	-	-	-	=1	-	7=	=0	-

- 1. MULLION CHART APPLIES TO NON-REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO GROUT FILLED OR HOLLOW BLOCK SUBSTRATES
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 4 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

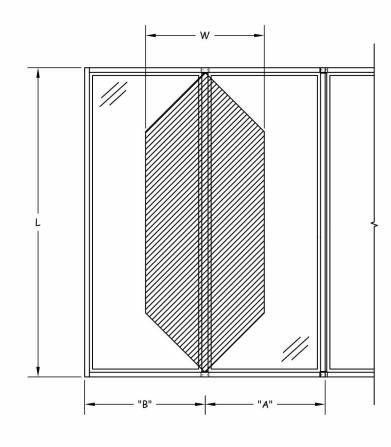

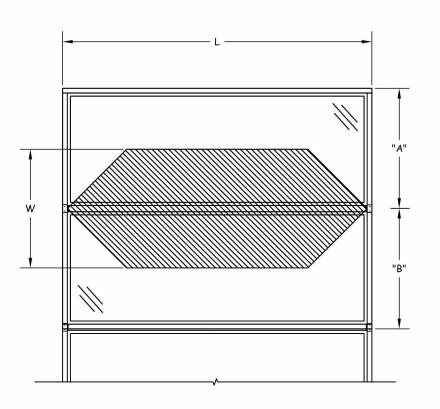

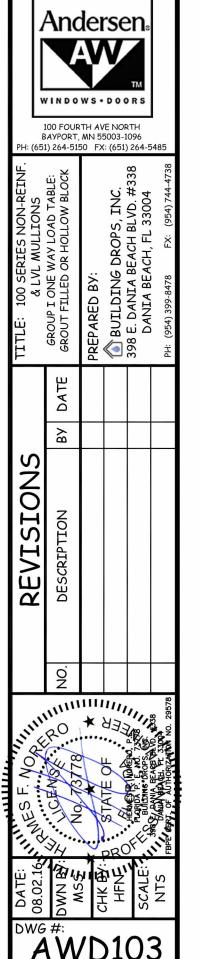


FIBERGLASS NON-REINFORCED MULL TABLE: GROUP II


DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO 2X WOOD/METAL STUD/CONCRETE INSTALLATIONS

					M	AXIMUM DE	SIGN PRESSU	RE CAPACITY	CHART (PSF): WOOD/N	IETAL STUD/	CONCRETE IN	STALLATION	<u>IS</u>					
L - Mull									W - Tr	ibutary Wid	th (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
54.0	45.0	45.0	45.0	45.0	45.0	43.1	40.8	38.9	37.5	36.5	35.8	35.4	35.3	35.3	35.3	35.3	35.3	35.3	35.3
57.0	45.0	45.0	45.0	42.1	38.7	36.1	34.0	32.3	31.0	30.0	29.3	28.8	28.5	28.4	28.4	28.4	28.4	28.4	28.4
60.0	45.0	44.5	39.5	35.7	32.8	30.5	28.6	27.2	26.0	25.1	24.3	23.8	23.4	23.2	23.1	23.1	23.1	23.1	23.1
63.0	44.1	38.2	33.9	30.6	28.1	26.0	24.4	23.1	22.0	21.1	20.5	19.9	19.5	19.3	19.1	19.0	19.0	19.0	19.0
66.0	38.2	33.1	29.4	26.5	24.2	22.4	21.0	19.8	18.8	18.0	17.4	16.9	16.5	16.2	16.0	15.9	15.8	15.8	15.8
69.0	33.3	28.9	25.6	23.0	21.0	19.4	18.1	17.1	16.2	15.5		-	-	-	-	-	-	-	-
72.0	29.3	25.3	22.4	20.2	18.4	17.0	15.8	-	-	-	-	-	-	-	-	-	-	-	-
75.0	25.9	22.4	19.8	17.8	16.2	-	ï	-	7-	-	-		-	-	-	-	-	-	
78.0	22.9	19.8	17.5	15.7	-	-	ř	-		-	-	-	-	-	-	-	-	-	-
81.0	20.5	17.7	15.6	1	-0	-	-	-	-	-	=	#0	-	-	-	-	-	-	-
84.0	18.3	15.8	-	1	-1	-	-	-	-	-	-		-	-	:-		-	-	
87.0	16.5	-		ı	-	-	-	-		-	-		-	-		-	-	-	-
90.0			-	Ξ	-		-8	-	-	-	-	-	=	-	-	-	-	-	-

NOTE:

- 1. MULLION CHART APPLIES TO NON-REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO 2X WOOD, METAL STUD, OR CONCRETE
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 4 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

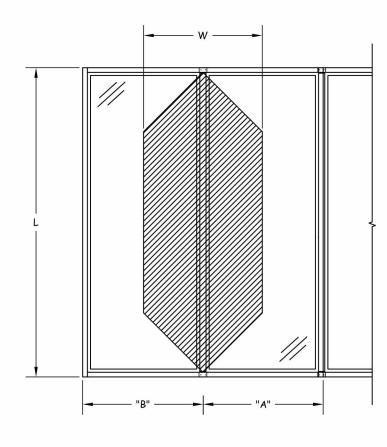

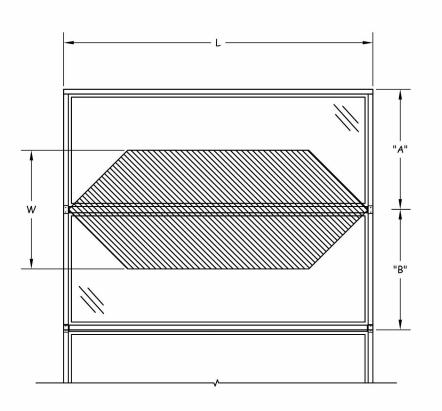




REVI


FIBERGLASS NON-REINFORCED MULL TABLE: GROUP II


DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO GROUT FILLED OR HOLLOW BLOCK SUBSTRATES

					MA	XIMUM DES	IGN PRESSUR	E CAPACITY	CHART (PSF)	: GROUT FIL	LED OR HOLL	OW BLOCK I	NSTALLATIO	NS					
L - Mull									W - Tr	ibutary Wid	th (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	44.5	41.9	39.9	38.4	37.3	36.6	36.1	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0
54.0	45.0	45.0	41.1	37.9	35.4	33.5	32.0	30.8	29.9	29.3	28.8	28.5	28.4	28.4	28.4	28.4	28.4	28.4	28.4
57.0	45.0	42.5	38.4	35.3	32.9	31.0	29.5	28.4	27.4	26.7	26.2	25.8	25.6	25.5	25.5	25.5	25.5	25.5	25.5
60.0	45.0	39.9	36.0	33.0	30.7	28.9	27.4	26.3	25.3	24.6	24.0	23.6	23.3	23.1	23.0	23.0	23.0	23.0	23.0
63.0	42.7	37.6	33.9	30.6	28.1	26.0	24.4	23.1	22.0	21.1	20.5	19.9	19.5	19.3	19.1	19.0	19.0	19.0	19.0
66.0	38.2	33.1	29.4	26.5	24.2	22.4	21.0	19.8	18.8	18.0	17.4	16.9	16.5	16.2	16.0	15.9	15.8	15.8	15.8
69.0	33.3	28.9	25.6	23.0	21.0	19.4	18.1	17.1	16.2	15.5		-	-	-	-	-	-	-	-
72.0	29.3	25.3	22.4	20.2	18.4	17.0	15.8	-	-	-	-	-	-	-	-	-	-	-	-
75.0	25.9	22.4	19.8	17.8	16.2	-	-	-	-	-		-	-	-	-	-	-	-	-
78.0	22.9	19.8	17.5	15.7	-		-	-	-	-	.=	-	-	-	-	-	-	-	-
81.0	20.5	17.7	15.6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
84.0	18.3	15.8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	=	-	-
87.0	16.5	-	-		-	1	-	-	-	-		-	-	-	-	-	-:	-	-
90.0	i	-	-	-	-		-	-	-	-	· -	-	7.4	-	-	-	-	-	-

- 1. MULLION CHART APPLIES TO NON-REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO GROUT FILLED OR HOLLOW BLOCK SUBSTRATES
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 4 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

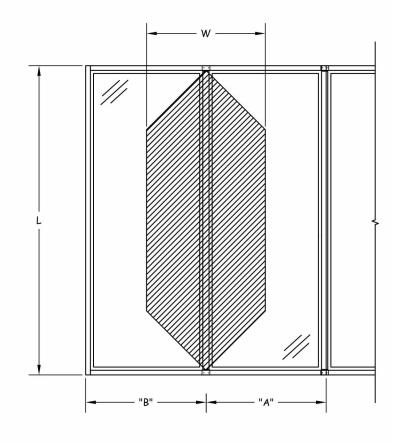

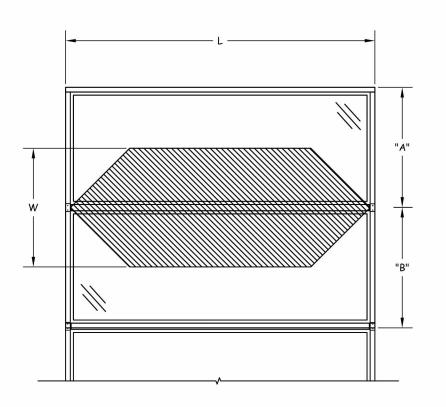

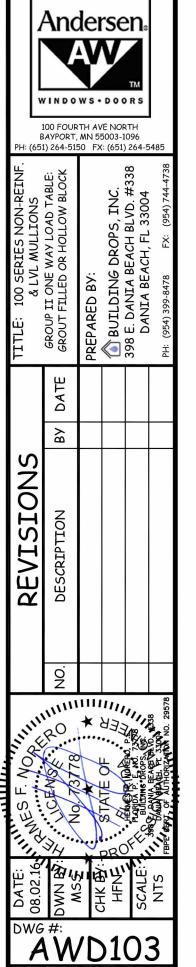


FIBERGLASS NON-REINFORCED MULL TABLE: GROUP III


DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO 2X WOOD/METAL STUD/CONCRETE INSTALLATIONS

					M	AXIMUM DE	SIGN PRESSUI	RE CAPACITY	CHART (PSF): WOOD/N	IETAL STUD/	CONCRETE IN	STALLATION	<u>1S</u>					
L - Mull									W - Tr	ibutary Wid	th (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
54.0	45.0	45.0	45.0	45.0	45.0	45.0	44.2	42.2	40.7	39.6	38.9	38.4	38.2	38.2	38.2	38.2	38.2	38.2	38.2
57.0	45.0	45.0	45.0	45.0	42.0	39.1	36.9	35.1	33.7	32.6	31.8	31.3	30.9	30.8	30.8	30.8	30.8	30.8	30.8
60.0	45.0	45.0	42.9	38.8	35.6	33.1	31.1	29.5	28.2	27.2	26.4	25.8	25.4	25.2	25.1	25.1	25.1	25.1	25.1
63.0	45.0	41.5	36.8	33.2	30.5	28.2	26.5	25.0	23.9	22.9	22.2	21.6	21.2	20.9	20.7	20.6	20.6	20.6	20.6
66.0	41.4	35.9	31.8	28.7	26.3	24.3	22.7	21.4	20.4	19.5	18.9	18.3	17.9	17.6	17.3	17.2	17.1	17.1	17.1
69.0	36.2	31.3	27.7	25.0	22.8	21.1	19.7	18.5	17.6	16.8	16.2	15.7	15.2	-	-	-	-	-	-
72.0	31.8	27.5	24.3	21.9	20.0	18.4	17.2	16.1	15.3	-	0=	7=	x=		-	æ	-	-	-
75.0	28.0	24.3	21.4	19.3	17.6	16.2	15.1	-	-	=0	1-	-	-	-	-	51 11	-	-	-
78.0	24.9	21.5	19.0	17.1	15.5	=	-	30	9	-	(=	-	1-	=	-	15	-	-	-
81.0	22.2	19.2	16.9	15.2	-	-	-	-	-	= 0	:=	\ <u>=</u>	1=	-	-	-	-	-	-
84.0	19.9	17.1	15.1	-:	-	-	-	-	-	-	s -	-	-	-	-	-	-	-	-
87.0	17.9	15.4	-	-	<u></u>	•	-	-	=	=.	. .	-	.=	=	-	-	-	-	-
90.0	16.1	3	-		-	1	-	-	-	20	Į	-	12	-	-	-	-	-	-

NOTE:

- 1. MULLION CHART APPLIES TO NON-REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO 2X WOOD, METAL STUD, OR CONCRETE
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 4 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

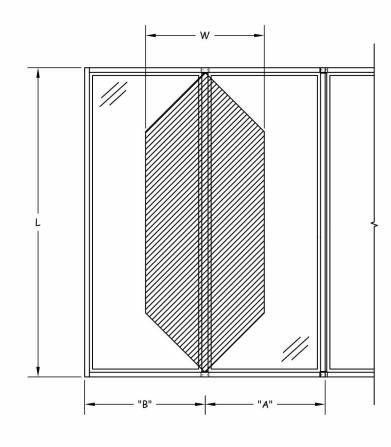

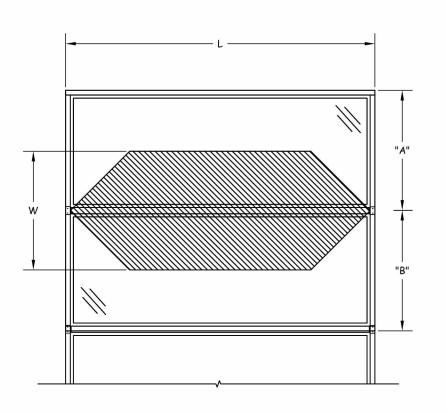



REVISIONS

& LVL MULLIONS

& LVL MULLIONS

& LVL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TITLE: 100 SERIES NON-REINF.

GROUP III ONE WAY LOAD TABLE: 2X

TITLE: 100 SERIES NON-REINF.

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

TOTAL MULLIONS

GROUP III ONE WAY LOAD TABLE: 2X

TOTAL MULLIONS

TOTAL MULLI

MN BY: YELL OF THE OF T

AWD103


:ts\andersen windows\fbc-15-1209 1


FIBERGLASS NON-REINFORCED MULL TABLE: GROUP III


DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO GROUT FILLED OR HOLLOW BLOCK SUBSTRATES

					MA	XIMUM DES	IGN PRESSUR	E CAPACITY	CHART (PSF)	: GROUT FIL	LED OR HOLL	OW BLOCK I	NSTALLATIO	<u>NS</u>					
L - Mull									W - Tr	ibutary Wic	th (in)								-
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	44.5	41.9	39.9	38.4	37.3	36.6	36.1	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0
54.0	45.0	45.0	41.1	37.9	35.4	33.5	32.0	30.8	29.9	29.3	28.8	28.5	28.4	28.4	28.4	28.4	28.4	28.4	28.4
57.0	45.0	42.5	38.4	35.3	32.9	31.0	29.5	28.4	27.4	26.7	26.2	25.8	25.6	25.5	25.5	25.5	25.5	25.5	25.5
60.0	45.0	39.9	36.0	33.0	30.7	28.9	27.4	26.3	25.3	24.6	24.0	23.6	23.3	23.1	23.0	23.0	23.0	23.0	23.0
63.0	42.7	37.6	33.9	31.0	28.8	27.0	25.6	24.4	23.5	22.8	22.2	21.6	21.2	20.9	20.7	20.6	20.6	20.6	20.6
66.0	40.4	35.6	31.8	28.7	26.3	24.3	22.7	21.4	20.4	19.5	18.9	18.3	17.9	17.6	17.3	17.2	17.1	17.1	17.1
69.0	36.2	31.3	27.7	25.0	22.8	21.1	19.7	18.5	17.6	16.8	16.2	15.7	15.2	=1	-	-	=	8	=
72.0	31.8	27.5	24.3	21.9	20.0	18.4	17.2	16.1	15.3	-	-	-	-	-	~		-	-	-
75.0	28.0	24.3	21.4	19.3	17.6	16.2	15.1	-	-	-	-	-	-	-	-	-		-	-
78.0	24.9	21.5	19.0	17.1	15.5	-	-	-	-		-	-	-	-	-	-		-	-
81.0	22.2	19.2	16.9	15.2	-	=	-	=	8	-	-	E	н	-	-		-	=	5
84.0	19.9	17.1	15.1	200	-	-	-	-	-	-	-	-	-		-	-		-	-
87.0	17.9	15.4	-	.=	-	-	-	-	-	o -	-	-	-	=x	-	-	-	-	-
90.0	16.1	-	8	=	-	81	-	-	-	-	Œ	-	-	=1	-	-	=	8	- 1


- 1. MULLION CHART APPLIES TO NON-REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: **GUSSET INSTALLATION TO GROUT FILLED OR HOLLOW BLOCK SUBSTRATES**
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 4 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

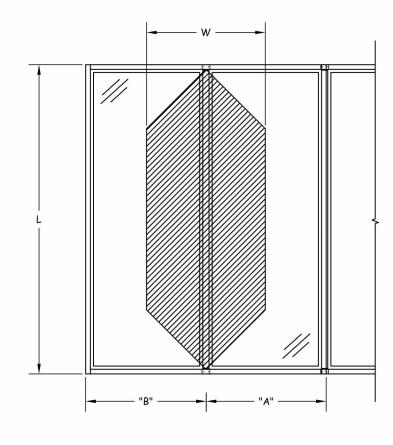

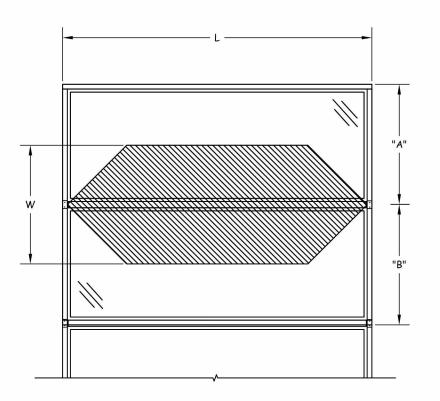

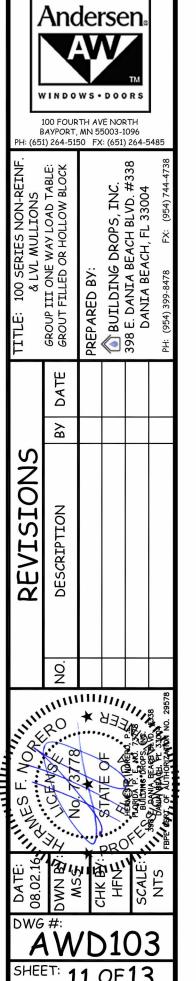



						MAXIMUM	DESIGN PRES	SSURE CAPA	CITY CHART	(PSF): 2X W	OOD/METAL	STUD/CONC	RETE/CMU						
L - Mull									W - Tr	ibutary Wic	th (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
48.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
54.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
60.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
63.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
66.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
69.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
72.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
75.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0
78.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.5	43.2	42.1	41.2	40.6	40.0	39.7
81.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.3	42.3	40.5	39.1	37.9	36.9	36.0	35.3	34.8	34.4
84.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.1	41.5	39.3	37.5	35.9	34.6	33.5	32.5	31.7	31.0	30.5	30.0
87.0	45.0	45.0	45.0	45.0	45.0	45.0	42.2	39.4	37.1	35.1	33.4	32.0	30.8	29.7	28.8	28.0	27.4	26.8	26.4
90.0	45.0	45.0	45.0	45.0	44.6	40.9	37.9	35.4	33.3	31.5	29.9	28.6	27.5	26.5	25.7	24.9	24.3	23.8	23.4
93.0	45.0	45.0	45.0	44.4	40.3	37.0	34.2	31.9	30.0	28.3	26.9	25.7	24.7	23.8	23.0	22.3	21.7	21.2	20.8
96.0	45.0	45.0	45.0	40.3	36.5	33.5	31.0	28.9	27.1	25.6	24.3	23.2	22.2	21.4	20.7	20.0	19.5	19.0	18.6
99.0	45.0	45.0	41.0	36.7	33.2	30.5	28.2	26.2	24.6	23.2	22.0	21.0	20.1	19.3	18.6	18.0	17.5	17.1	16.7
102.0	45.0	42.5	37.4	33.5	30.3	27.8	25.7	23.9	22.4	21.1	20.0	19.1	18.3	17.5	16.9	16.3	15.8	15.4	15.0
105.0	45.0	38.9	34.3	30.6	27.7	25.4	23.5	21.8	20.5	19.3	18.3	17.4	16.6	15.9	15.4	-	-	-	-
108.0	41.5	35.8	31.4	28.1	25.4	23.3	21.5	20.0	18.7	17.7	16.7	15.9	15.2	===	-	-	-	-	-
111.0	38.2	32.9	28.9	25.8	23.4	21.4	19.8	18.4	17.2	16.2	15.3	-	-	-	-	-	-	-	-
114.0	35.3	30.3	26.7	23.8	21.6	19.7	18.2	16.9	15.8	-	~=	-	-	= 2	-	-	=:	-	-
117.0	32.6	28.1	24.6	22.0	19.9	18.2	16.8	15.6	-	-	-	-	-	-	-	-	-	-	-
120.0	30.2	26.0	22.8	20.4	18.4	16.9	15.5	-	-	-		-	-			-		-	

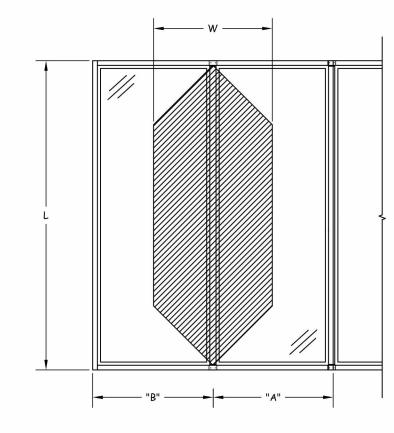



- 1. MULLION CHART APPLIES TO LVL REINFORCED ASSEMBLIES, WHEN MULLED IN ONE-WAY, STACK OR RIBBON, CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER **SEPARATE FL APPROVAL.**
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO 2X WOOD, METAL STUD, GROUT FILLED OR HOLLOW BLOCK, OR CONCRETE.
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 5 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

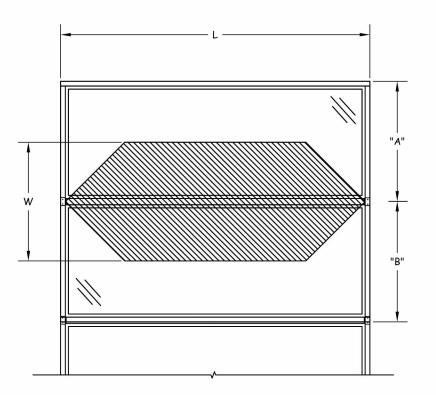



REVI


BY

DESIGN PRESSURE CAPACITIES FOR INSTALLATION INTO 2X WOOD/METAL STUD/CONCRETE/HOLLOW BLOCK/GROUT FILLED BLOCK SUBSTRATES

					MA	XIMUM DES	IGN PRESSU	RE CAPACIT	Y CHART (PSI	F): 2X WOO	D/METAL ST	UD/CONCRE	TE/MASON	RY					
L - Mull									W - Tr	ibutary Wid	th (in)								
Length (in)	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0
36.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	64.2	61.4	58.9
42.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	55.1	52.7	50.5
48.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	48.2	46.1	44.2
54.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.9	42.8	41.0	39.3
60.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.6	42.4	40.4	38.5	36.9	35.3
63.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.9	42.5	40.4	38.5	36.7	35.1	33.6
66.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	42.8	40.6	38.5	36.7	35.0	33.5	32.1
69.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	43.4	41.0	38.8	36.9	35.1	33.5	32.1	30.7
72.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	44.2	41.6	39.3	37.2	35.3	33.6	32.1	30.7	29.4
75.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	42.8	40.1	37.8	35.7	33.8	32.1	30.6	29.2	27.9	26.8
78.0	45.0	45.0	45.0	45.0	45.0	45.0	45.0	43.9	40.8	38.1	35.7	33.6	31.7	30.1	28.5	27.2	26.0	24.8	23.8
81.0	45.0	45.0	45.0	45.0	45.0	45.0	42.5	39.2	36.4	34.0	31.9	30.0	28.3	26.8	25.5	24.3	23.2	22.2	21.2
84.0	45.0	45.0	45.0	45.0	45.0	41.6	38.1	35.2	32.7	30.5	28.6	26.9	25.4	24.1	22.9	21.8	20.8	19.9	19.0
87.0	45.0	45.0	45.0	45.0	41.1	37.4	34.3	31.7	29.4	27.4	25.7	24.2	22.9	21.7	20.6	19.6	18.7	17.9	17.1
90.0	45.0	45.0	45.0	41.3	37.2	33.8	31.0	28.6	26.5	24.8	23.2	21.9	20.6	19.6	18.6	17.7	16.9	16.2	15.5
93.0	45.0	45.0	42.1	37.4	33.7	30.6	28.1	25.9	24.1	22.5	21.1	19.8	18.7	17.7	16.8	16.0	15.3	-	-
96.0	45.0	43.8	38.3	34.0	30.6	27.8	25.5	23.6	21.9	20.4	19.1	18.0	17.0	16.1	15.3	-	-	-	-
99.0	45.0	39.9	34.9	31.0	27.9	25.4	23.3	21.5	19.9	18.6	17.5	16.4	15.5	-	-	-	-	-	-
102.0	42.6	36.5	31.9	28.4	25.5	23.2	21.3	19.6	18.2	17.0	16.0	15.0	-	-	-	-	-	-	-
105.0	39.0	33.4	29.3	26.0	23.4	21.3	19.5	18.0	16.7	15.6	-	-	-	-	-	-	7-	-	-
108.0	35.8	30.7	26.9	23.9	21.5	19.6	17.9	16.5	15.4	-	-	-	-	-0	-	-	:-	-	-
111.0	33.0	28.3	24.8	22.0	19.8	18.0	16.5	15.2	-,			-	-		-	-	,-	-	-
114.0	30.5	26.1	22.9	20.3	18.3	16.6	15.2	=	н	-	-	=	-	-0	=	=	-	=	-
117.0	28.2	24.2	21.1	18.8	16.9	15.4	-1	-		1-		-	-	-10	-	-	1-	-:	-
120.0	26.1	22.4	19.6	17.4	15.7	-		-	-1	-		-	-		-1	-	-	-	-

NOTE:

- 1. MULLION CHART APPLIES TO LVL REINFORCED ASSEMBLIES, WHEN MULLED IN TWO-WAY, 'X' OR 'T' CONFIGURATIONS.
- 2. DESIGN PRESSURE VALUES ARE POSITIVE AND NEGATIVE IN PSF.
- 3. MAXIMUM DEFLECTION HAS BEEN LIMITED TO L/175.
- 4. DESIGN PRESSURE OF ASSEMBLY IS LIMITED TO THE LESSER DESIGN PRESSURE OF THE MULLION ASSEMBLY OR THE INDIVIDUAL UNIT OF INSTALLATION. ADJACENT WINDOWS SHALL BE UNDER SEPARATE FL APPROVAL.
- 5. MULLION CHART APPLIES TO THE FOLLOWING INSTALLATION CONDITIONS: GUSSET INSTALLATION TO 2X WOOD, METAL STUD, GROUT FILLED OR HOLLOW BLOCK, OR CONCRETE
- 6. TRIBUTARY WIDTH = W = (A+B)/2
- 7. REFER TO SHEET 5 FOR INSTALLATION DETAILS.
- 8. WHEN WINDOWS ARE STACKED VERTICALLY, THE MANUFACTURER/INSTALLER SHALL ENSURE THAT THE WEIGHT OF UNITS ABOVE WILL NOT CAUSE DEFLECTIONS OR STRESSES WHICH WILL AFFECT OPERATION OR STRUCTURAL ADEQUACY OF UNITS BELOW.

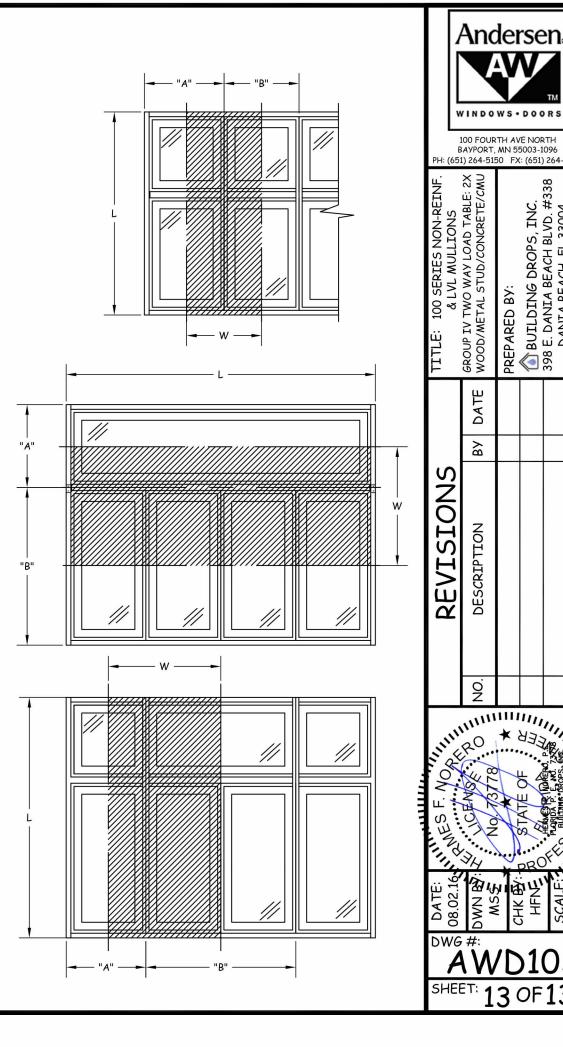

2016 6:56 PM

c-15-1209 100 series mullion table vertical & horizontal\dwgs\awd103

scts\andersen windows\fbc-15-1209 100 series mullion table verti