
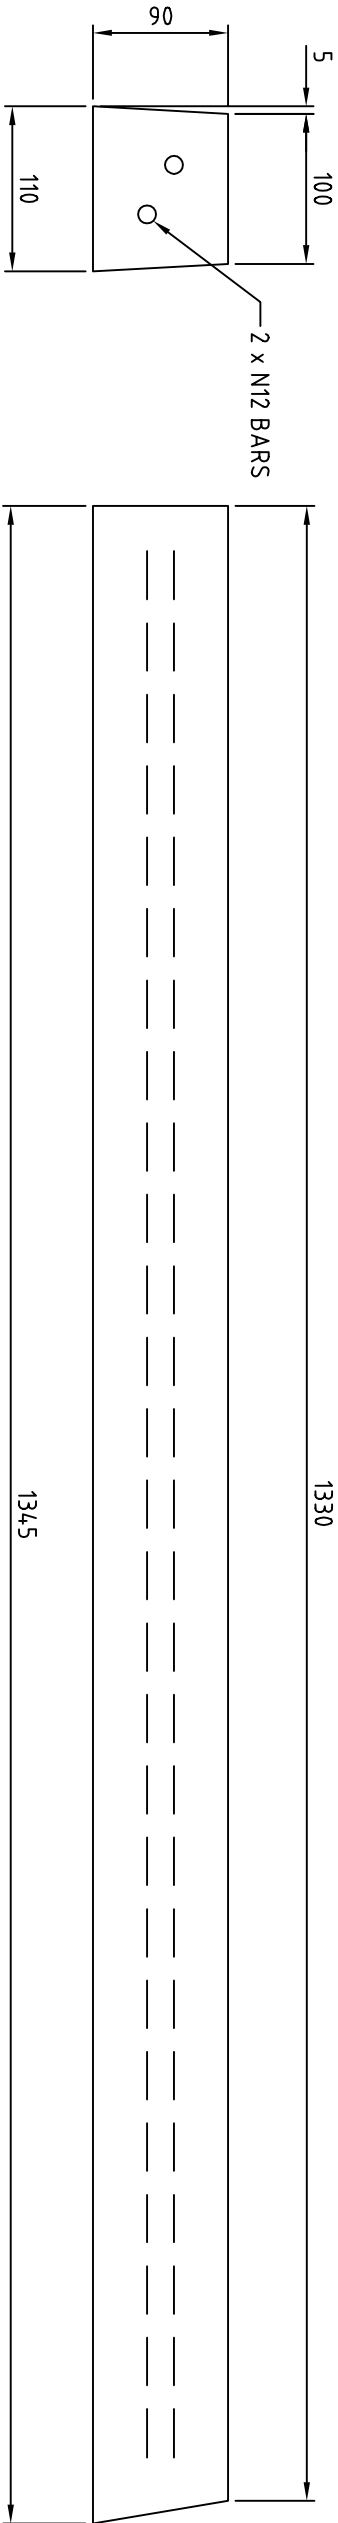


1. REINFORCEMENT:-
- 2 x N12 - COVER MIN 30mm.
2. CONCRETE QUALITY SHALL COMPLY WITH AS3600 & THE FOLLOWING:-
- SLUMP.....80mm
- MAX. AGG. SIZE.....10mm
- CEMENT.....TYPE GP TO AS3972
- GRADE OF CONCRETE.....25MPa @ 28 DAYS
- COLOUR.....SANDSTONE COLOUR OXIDE TO BE ADDED TO CONCRETE MIX IN ACCORDANCE WITH MANUFACTURES RECOMMENDATIONS.

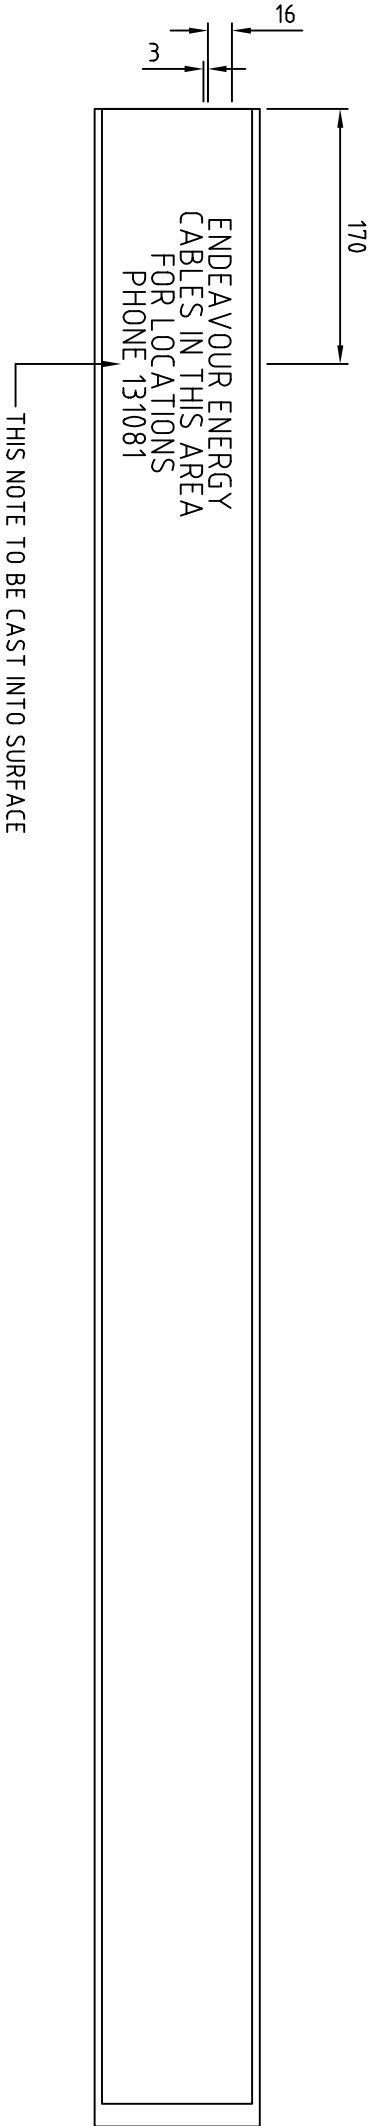

AMENDMENTS		ORIGINAL ISSUE		J R No.		N/A	
A							
1		2		3		4	
DRAWN		BF		DATE		14.02.06	
CHD		RJH					
ORIGINAL SCALE 1:5		APPROVED Glen Parry		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		REFERENCE DRAWINGS		AUTHORISED D.Asvestas/GST		MGR TRANSMISSION CAPITAL PROJECTS 28/2/06	
UNDERGROUND HV CABLE ROUTE MARKER POST INSTALLED IN OPEN AREAS DETAIL		A3		303319		A	
				SHEET No 1 OF 1 SHEETS			